

My Company Name


My Address

Asphalt Marshall Mix Analysis

To: City of Apples
c/o Schell Drew Inc.
#10 - 3307 nomore Road SE
Apple City, KT
23456

Project: 2006 Top Lift Asphalt
Northlands

Project Number: M06-05-3704
Report Number: 1
Report Date: 25-May-06
Sample Type: S2 - 12.5mm
Sampled By: EGT/DS
Source: EGT
Sample Date: 04-May-06
Date Received: 04-May-06
Date Tested: 24-May-06

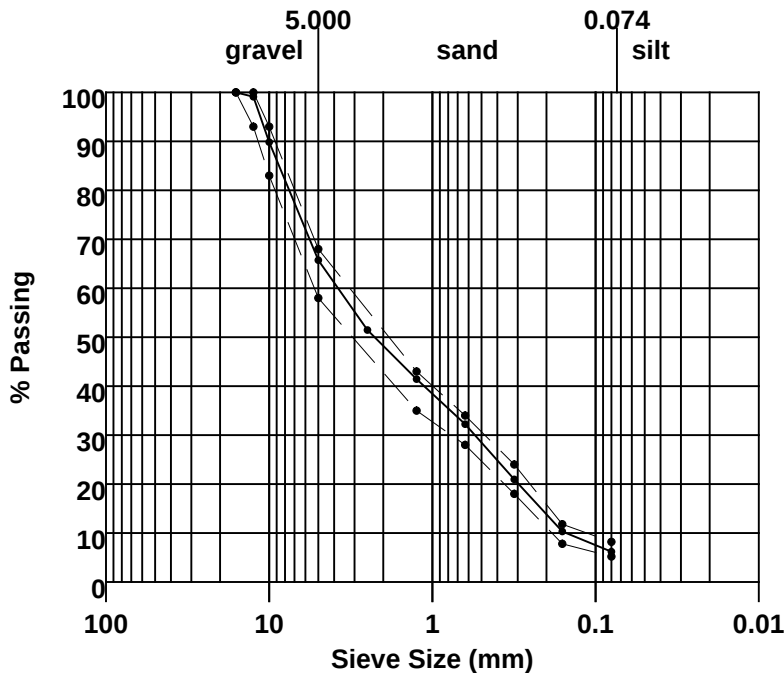

Sieve Size (mm)	% Passing	Spec. Low (%)	Spec. High (%)
16.00	100.00	100.00	100.00
12.50	99.11	93.00	100.00
10.00	89.84	83.00	93.00
5.00	65.73	58.00	68.00
2.50	51.46		
1.25	41.44	35.00	43.00
0.63	32.23	28.00	34.00
0.32	20.96	18.00	24.00
0.16	10.32	7.80	11.80
0.08	6.19	5.20	8.20

Maximum Theoretical Density: 2457.5

Specs

	A	B	C	D	Avg	Min	Max
Stability (kN)	10.5	11.3	11.0		10.9		
Flow (mm)	3.5	4.4	4.4		4.1		
Flow (0.25 mm)	14.0	17.7	17.6		16.4		
Density (kg/m³)	2382	2384	2375		2380		

Initial Weight
Final Weight
No. of Blows
Compaction Temp.
Field Temp.
Bulk S. G.
Asphalt S. G.
Absorbed Asphalt (%)
Percent Air Voids
V.M.A. (%)
V.F.A. (%)
Film Thickness (um)
% by Wt. of Aggregate
% by Wt. of Total Mix

Measured	Spec Min	Spec Max
3008.6		
2832.3		
50		
105		
136		
2.6		
1.03		
0.32		
3.15		
13.1		
76.0		
6.72		
5.38		
5.10		

Northlands Cres., 14m E of Northland Way, 2m N of S curb
S2 - 6 INCH

Per: _____