

# My Company Name

My Address


To: Lafarge Inc.  
 Box 727  
 149 - Veiner Road  
 Brooks

Patrick Humphreys

Project: 2003 Materials Testing  
 Brooks shop

# Hydrometer Analysis Report

Project Number: M03-01-2019  
 Report Number: 1  
 Report Date: 1/16/2003  
 Sampled By: Client  
 Tested By: EGT  
 Sample Date: 1/8/2003  
 Date Received: 1/9/2003  
 Date Tested: 1/15/2003

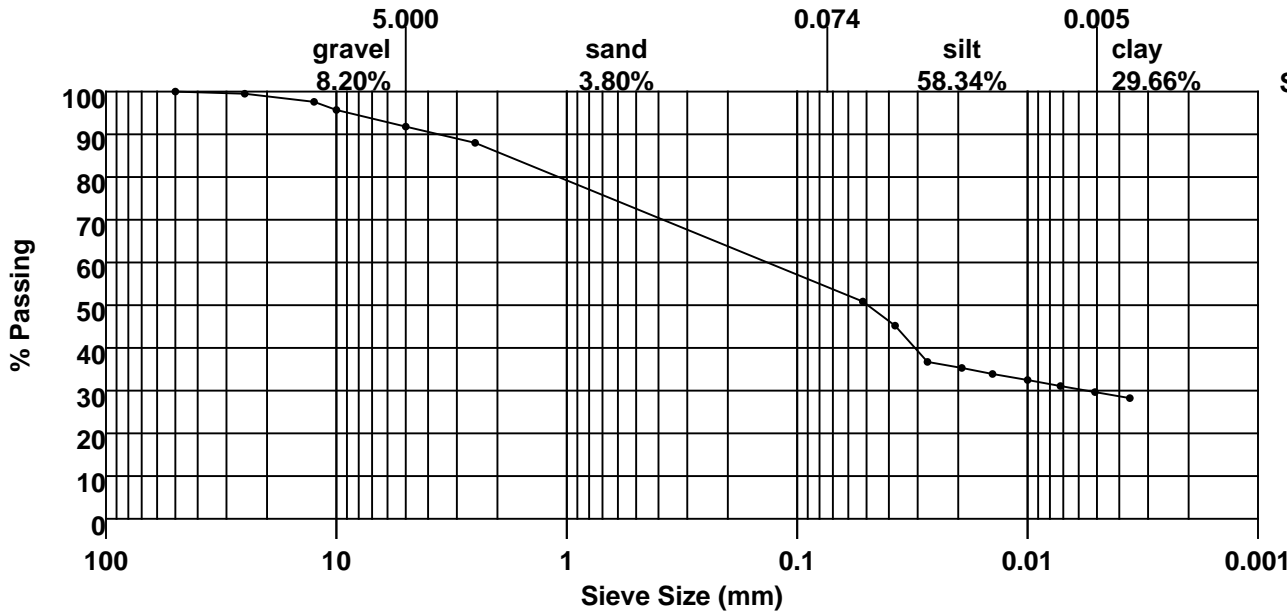

Sieve Size (mm)	% Passing	Percent Retained
50.0000	100.0	0.0
25.0000	99.5	0.5
12.5000	97.6	1.9
10.0000	95.7	1.9
5.0000	91.8	3.9
2.5000	88.0	3.8
0.0519	50.9	37.1
0.0376	45.2	5.7
0.0272	36.7	8.5
0.0193	35.3	1.4
0.0142	33.9	1.4
0.0100	32.5	1.4
0.0072	31.1	1.4
0.0051	29.7	1.4
0.0036	28.2	1.4

Due to the percentages of granular on cohesive material, this soil is classified as a sandy clay. Based on these results and the Safety Codes Council & Alberta Private Sewage Systems Standard of Practices (1999), the soil is not suitable for disposal fields without further testing.

Per: \_\_\_\_\_