

My Company Name

My Address

To: Lahrmann Engineering Ltd.
 #105 1301 - 8 Street SW.
 Anytown, KS


Dave Paslawski

Project: ESA Phase II
 Maple Creek

Proctor Report

Project Number: M95-11-814
 Report Number: 2
 Report Date: 28-Nov-95
 Copies To: Client
 Sample Type: 3/4" road crush
 Sampled By: SGI/DB
 Tested By: Site
 Source: SGI/WS
 Sample Date: 28-Nov-95
 Date Received: 24-Nov-95
 Date Tested: 24-Nov-95

Rammer Type: MANUAL
 Preparation: MOIST
 Method: ASTM-D698-C

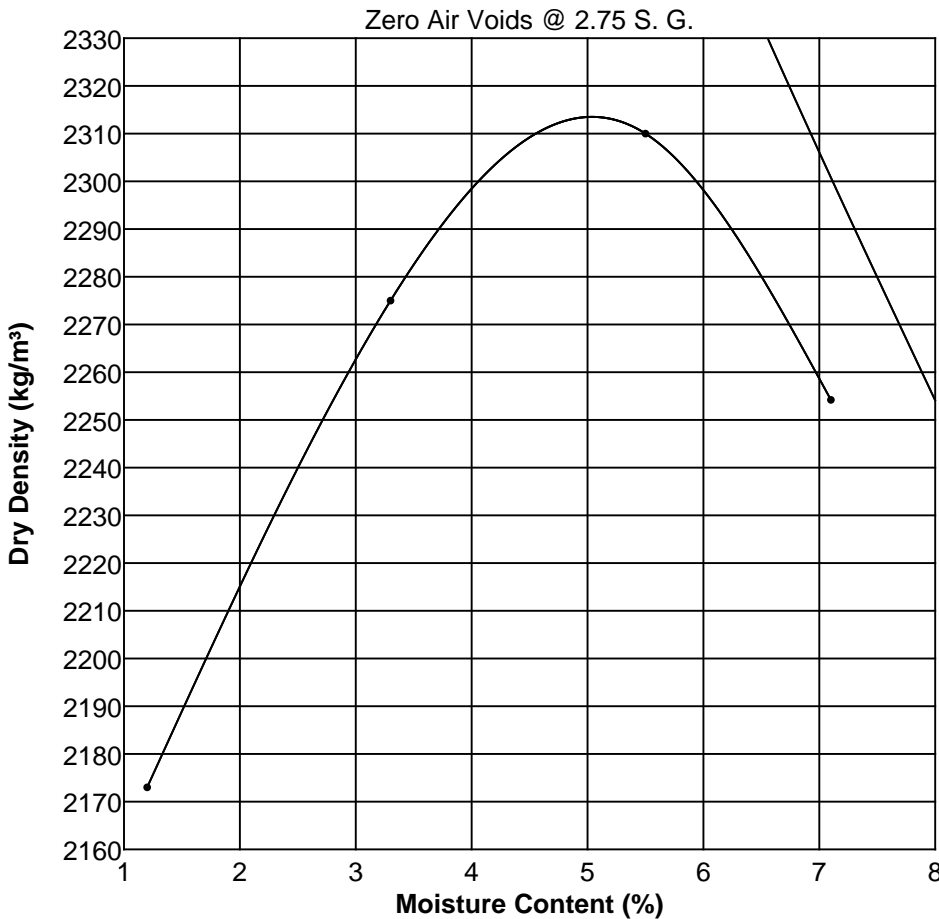

Optimum	Max Dry
Moisture	Density
(%)	(kg/m³)
5.0	2313.5
4.7	2350.8
4.3	2389.4
4.0	2429.2
3.6	2470.3
3.3	2512.9

Moisture	Dry	Wet
Content	Density	Density
(%)	(kg/m³)	(kg/m³)
1.2	2173.0	2199.1
3.3	2275.0	2350.1
5.5	2310.0	2437.1
7.1	2254.2	2414.2

3/4" Road Crush

Per: _____